Model: PUHY-HP72THMU-A – DIMENSIONS

Unit : mm(in)

<Accessories>(Supplied only with the unit listed below)
- Connecting pipe <gas> ..... 1 pc.
  - ·PUHY-HP72THMU Models ..... Packaged with other accessories
  - ·PUHY-HP96THMU Models ..... Mounted on the refrigerant service valve
- Connecting pipe <liquid> ..... 1 pc.
  - ·PUHY-HP72,96THMU Models ..... Packaged with other accessories (For standalone use)
- Packing for connecting pipe <gas> ..... 1 pc.
  - Mounted adjacent to the refrigerant service valve on the gas side
  - ·PUHY-HP72,96THMU Models

Note. Refer to the Installation Manual for information regarding necessary clearance around the unit and foundation.

NO.	Usage		Specifications
①	For pipes	Front access hole	102 X 72 Access hole (4-1/32)(2-27/30)
②		Bottom access hole	150 X 92 Access hole (5-29/32)(3-5/8)
③	For wires	Front access hole	Ø65 or Ø40 Access hole (2-9/16) (1-19/32)
④		Front access hole	Ø 52 or Ø27 Access hole (2-1/16) (1-3/32)
⑤		Bottom access hole	Ø 52 Access hole (2-1/16)
⑥	For transmission cables	Front access hole	Ø 34 Access hole (1-11/32)

Connecting pipe specifications

Model	Position dimensions for the refrigerant service valve			Connection specifications for the refrigerant service valve		
	Liquid	Gas		Liquid		Gas
	A	B *1	C			
PUHY-HP72THMU	290 (11-7/16)	161 (6-11/32)	145 (5-23/32)	Multiple unit installation	Ø9.52 Flare (3/8)	Ø19.05 Brazed (3/4)
PUHY-HP96THMU	(242)*2 (9-17/32)	165 (6-1/2)	142 (5-19/32)	(Single unit installation)	Ø12.7 Brazed (1/2)	Ø22.2 Brazed (7/8)

*1 Indicates the dimensions for use with the pipe that is supplied.
*2 Indicates dimensions and connection specifications appropriate to installing the unit as a single unit.

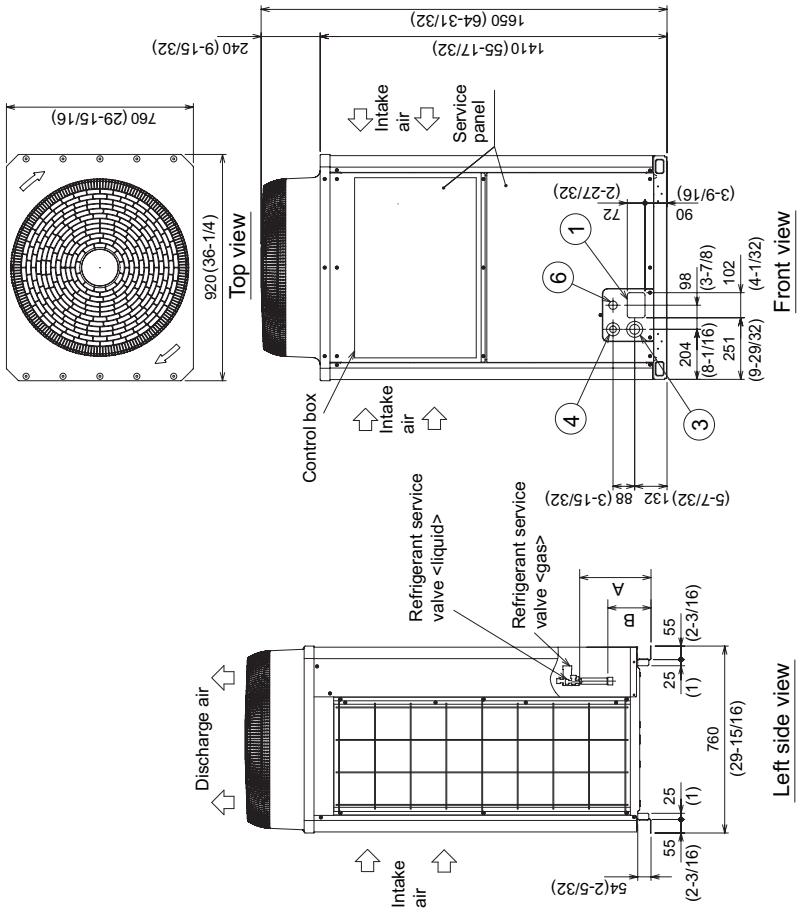

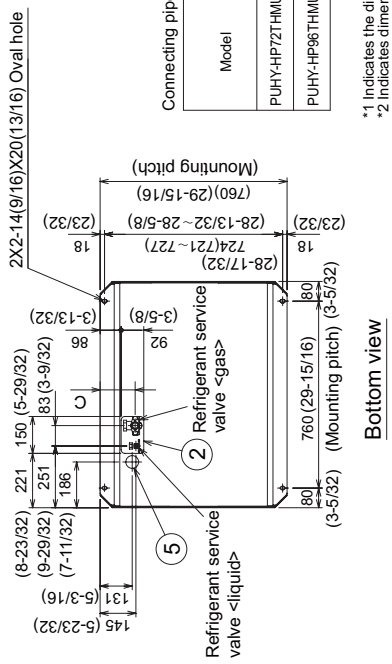

Certificate Number FM33568

Mitsubishi Electric Air Conditioning & Refrigeration Systems Works acquired ISO 9001 certification under Series 9000 of the International Standard Organization (ISO) based on a review of quality warranties for the production of refrigeration and air conditioning equipment.

ISO Authorization System
The ISO 9000 series is a plant authorization system relating to quality warranties as stipulated by the ISO. ISO 9001 certifies quality warranties based on the "design, development, production, installation and auxiliary services" for products built at an authorized plant.

Certificate Number EC97J1227

Mitsubishi Electric Air Conditioning & Refrigeration Systems Works acquired environmental management system standard ISO 14001 certification.

The ISO 14000 series is a set of standards applying to environmental protection set by the International Standard Organization (ISO).

MITSUBISHI ELECTRIC
HVAC Advanced Products Division
Mitsubishi Electric & Electronics USA, Inc.
3400 Lawrenceville Suwanee Rd.
Suwanee, GA 30024
Tele: 678-376-2900 • Fax: 800-889-9904
Toll Free: 800-433-4822 (#4)
www.mehvac.com

Specifications are subject to change without notice.

 © MITSUBISHI ELECTRIC / HVAC 2007